TLG Acoustic Labs

1865 Heritage Ranch Drive
Farr West, UT 84404

Test #	TLG-111-100-116
Test Date:	30-Jun-18
Mounting per ASTM E795-00:	A Mount
Area Tested: M²	9.29
Temperature: °C	25
Barometer: pa	100700
Humidity: %	61

NRC	0.95
SAA	0.94
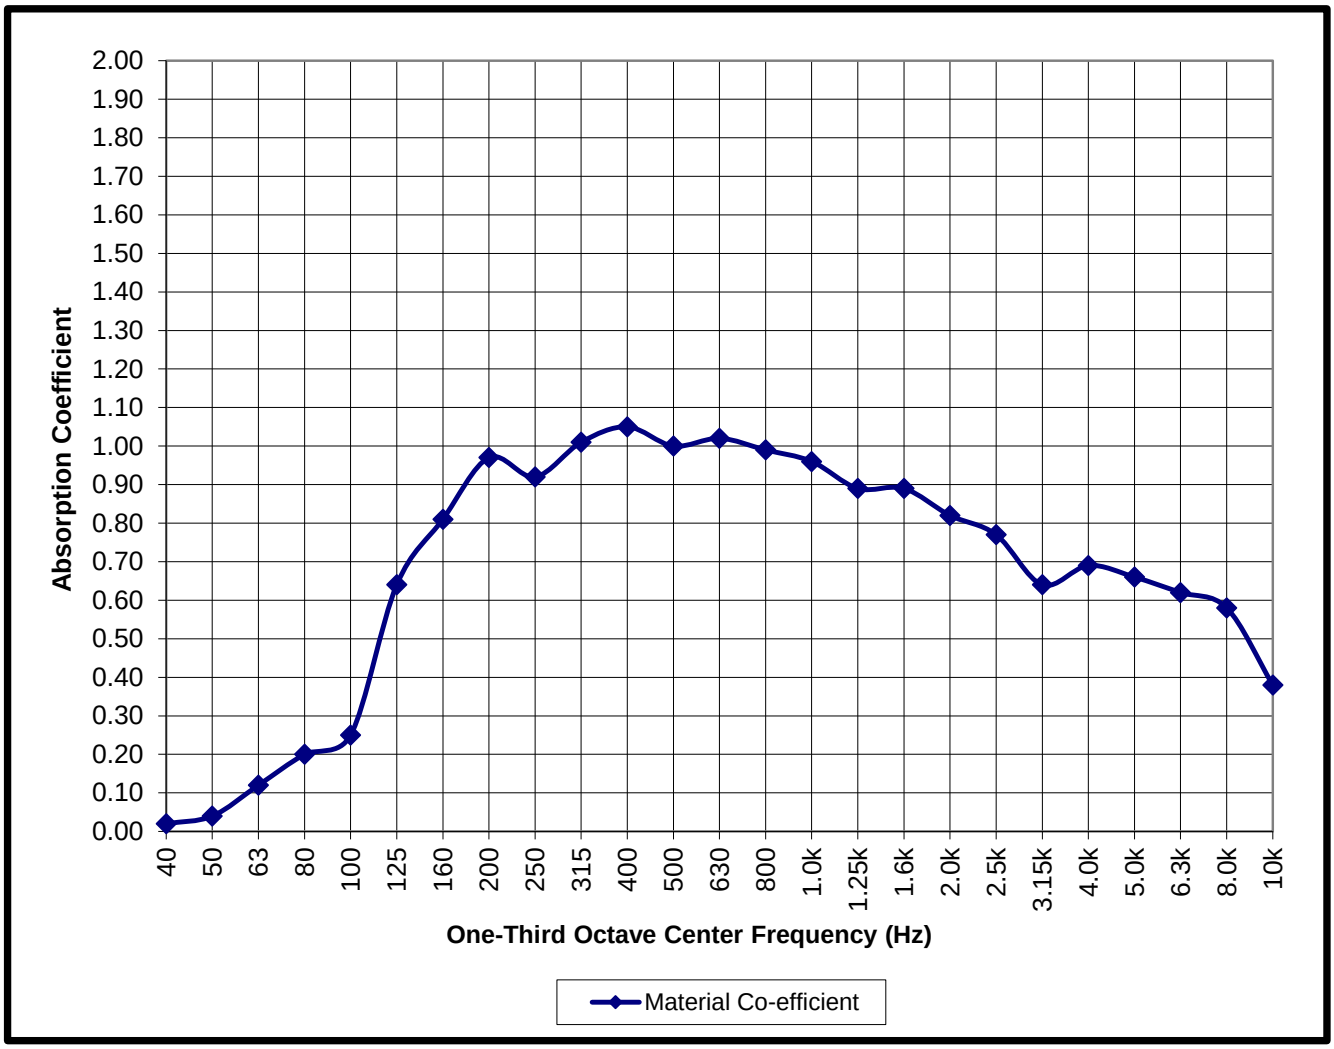
DSA 14 2 w 3in 6Lb